
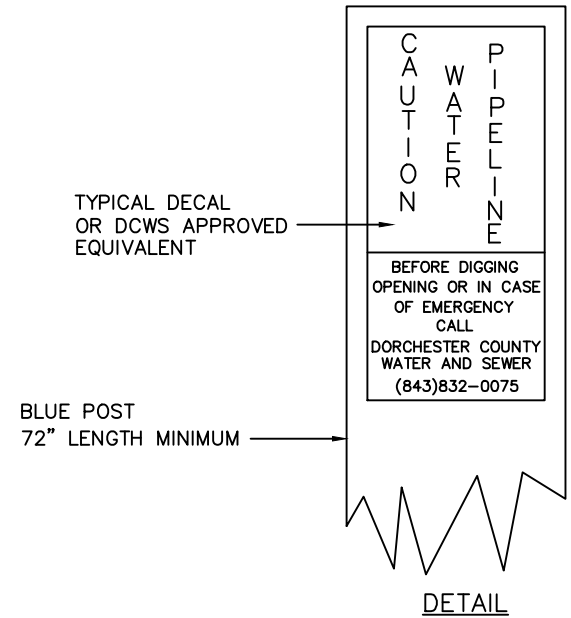


NOTE: PIPELINE MARKERS TO BE LOCATED:

1. EVERY 500' MINIMUM ALONG THE WATER MAIN.
2. AT WATER MAIN FITTINGS WHERE THE ALIGNMENT CHANGES.
3. AT TRACER WIRE/DUMMY VALVE BOX LOCATIONS.
4. AT ALL VALVES AND ARVS OR AS DIRECTED BY DCWS.

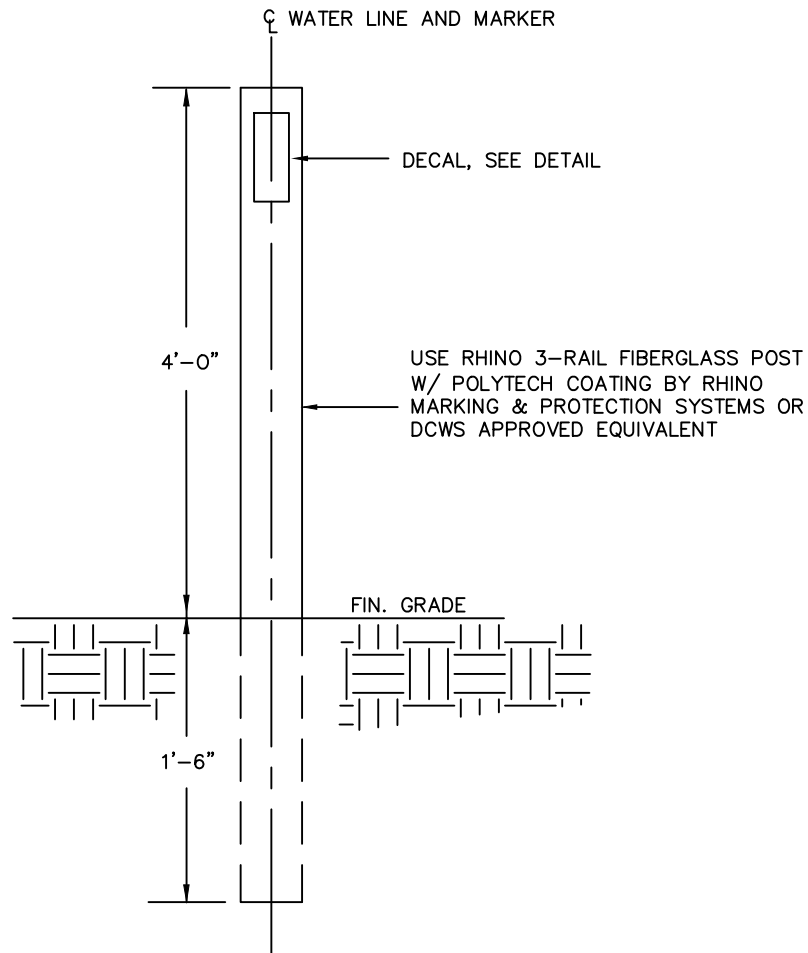

DORCHESTER COUNTY WATER & SEWER	
WATER LINE FIBERGLASS MARKER POST	DRAWING: W-19
DATE: <u> JULY 2025 </u>	DRAWN BY: <u> STL </u>
SCALE: <u> NTS </u>	APPROVED BY: <u> JDC </u>