
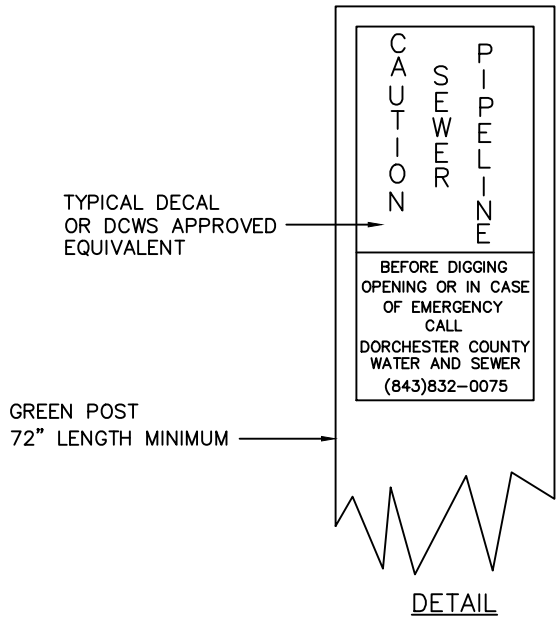


- NOTE: PIPELINE MARKERS TO BE LOCATED:
1. EVERY 500' MINIMUM ALONG THE SEWER FORCE MAIN.
 2. AT FORCE MAIN FITTINGS WHERE THE ALIGNMENT CHANGES
 3. AT TRACER WIRE/DUMMY VALVE BOX LOCATIONS
 4. BESIDE MANHOLES WHERE VEGETATIVE GROWTH IS HIGH FOR LOCATING PURPOSES

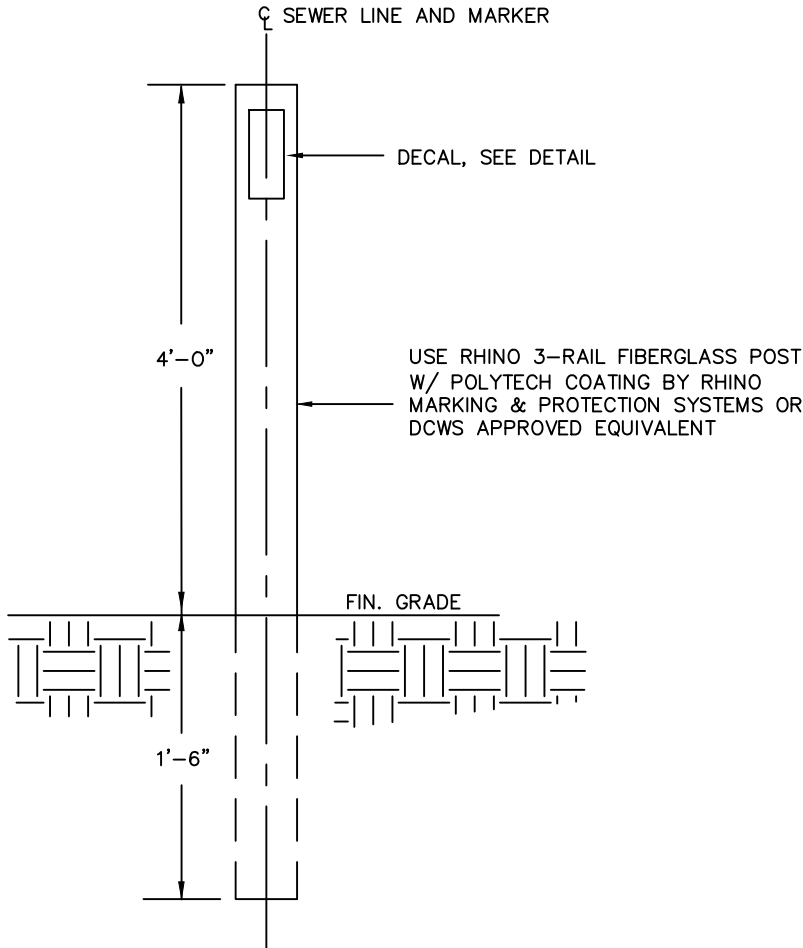

DORCHESTER COUNTY WATER & SEWER	
SEWER LINE FIBERGLASS MARKER POST	DRAWING: S-26
DATE: <u> JULY 2025 </u>	DRAWN BY: <u> STL </u>
SCALE: <u> NTS </u>	APPROVED BY: <u> JDC </u>